



Edwards Air Force Base California



2024 Water Quality Report

2024 Monitoring Results for Edwards AFB – Main Base (Public Water System ID: CA1510701) Prepared By: 412th Test Wing – Bioenvironmental Engineering Flight

Annual Consumer Report

We feel it is important that our consumers know about where our water comes from, what it contains, and how it compares to requirements set by regulatory agencies. This report is a snapshot of last year's water quality.

Last year, our tap water met or exceeded all U.S. Environmental Protection Agency (USEPA) and state drinking water health requirements. See page 6 for detailed information regarding lead sample results and education.

Through regular monitoring, any contaminants found were verified to be within regulatory standards. The detected amounts and the associated standards, are included in the tables published within this report.

Where Does Our Water Come From?

The Main Base Drinking Water System draws water from two sources:

- Antelope Valley East Kern (AVEK) Water Agency
- On-base groundwater wells

Edwards AFB Main Base receives a majority of our water supply from the AVEK Water Agency. The water received from the AVEK is supplied to Main Base in finished drinking water quality form. The AVEK main water source is the California Aqueduct. AVEK's alternative supply is from the State Water Project, which is water stored in the aquifer at various underground storage facilities (i.e. "water banks"). This water is extracted as local groundwater for water quality purposes or as supply during drought. As a water wholesaler, the AVEK Water Agency published their 2024 Water Quality Report earlier this year, which is located at <https://www.avek.org/2024-annual-water-quality-report-kern-county-system>

Additionally, groundwater can be extracted from one out of six active installation wells. Although throughout 2024, the wells only served as a back-up function to AVEK supply. These wells are fed by the Antelope Valley Aquifer.

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.

Treatment Process

Our water is treated with chlorine, a disinfectant which kills dangerous bacteria and other microorganisms that may be in the water. The 412th Civil Engineering Squadron monitors the disinfectant levels on a daily basis.



Pictured above: A technician from the 412th Operational Medical Readiness Squadron, Bioenvironmental Engineering Flight conducting routine water testing at locations spanning the water distribution system. Water samples are collected, tested by a certified laboratory, and results are submitted to the State Water Resources Control Board to demonstrate compliance with all requirements and regulations.

Source Water Assessment

The 412th Civil Engineering (CE) Squadron completed our Source Water Assessment on 18 June 2003 and it is on file in the CE Water & Gas office (661-277-5000). This assessment looks at possible contamination sources that may affect the base water supply. Possible contaminating activities for the wells surveyed in this assessment include nearby abandoned wells, storm drainage discharge, above ground water storage tanks, and nearby roads. The health risks from these activities are diminished through weekly monitoring of the potable water system.

EAFB is aware that many buildings at Main Base use bottled water. EAFB is not responsible for sampling or for reporting on bottled water. Water quality reports for your bottled water may be obtained by contacting your building's bottled water vendor.

What Is In Drinking Water?

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. **The presence of contaminants does not necessarily indicate that the water poses a health risk.** More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's (EPA) Safe Drinking Water Hotline (1-800-426-4791).

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- Inorganic contaminants, such as salts and metals, that can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and herbicides, that may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, that are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, agricultural application, and septic systems.
- Radioactive contaminants, that can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (USEPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Board regulations also establish limits for contaminants in bottled water that provide the same protection for public health.

Consumption Note for Susceptible Individuals

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (1-800-426-4791).

Water Quality Data Table

All sources of drinking water contain some naturally occurring contaminants. At low levels, these substances are generally not harmful in our drinking water. Removing all contaminants would be extremely expensive, and in most cases, would not provide increased protection of public health. Additionally, some naturally occurring minerals provide benefits by improving the taste of drinking water and providing nutritional value at low levels.

In order to ensure that tap water is safe to drink, the USEPA prescribes regulations which limit the amount of contaminants in water provided by public water systems. The tables on the following pages list all of the drinking water contaminants that were detected during the 2024 calendar year of this report. Many more contaminants were tested than listed on the following table; only those substances listed below were detected in our water. The USEPA and state allow us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently, or because the system is not considered vulnerable to this type of contamination. As such, some of our data, though representative, is more than one year old.

In these tables you may find terms and abbreviations that might not be familiar to you. To help you better understand these terms, we have provided the definitions below.

Important Terms Used

Term	Definition
AL	Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.
LRAA	Local Running Annual Average: Annual running average at a single sampling site.
HAA5	Sum of Five Regulated HAAs, i.e., Monochloroacetic Acid, Monobromoacetic Acid, Dichloroacetic Acid, Dibromoacetic Acid, and Trichloroacetic Acid
MCL	Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs are set to protect the odor, taste, and appearance of drinking water.
MCLG	Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. Environmental Protection Agency.
mg/L	Mg/L: Milligrams per Liter (ppm)
N/A	Not Applicable
ND	Not Detected
pCi/L	pCi/L: picocuries per liter (a measure of radioactivity)
PDWS	Primary Drinking Water Standards: MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.
PHG	Public Health Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California Environmental Protection Agency.
ppb	ppb: parts per billion, or micrograms per liter (µg/L)
ppm	ppm: parts per million, or milligrams per liter (mg/L)
SDWS	Secondary Drinking Water Standards: MCLs for contaminants that affect taste, odor, or appearance of the drinking water. Contaminants with SDWSs do not affect the health at the MCL levels.
TTHM	Total Trihalomethanes, or Sum of Four Regulated THMs, i.e., Chloroform, Bromodichloromethane, Dibromochloromethane, and Bromoform
µs/cm	µs/cm: micro Siemens per centimeter (a measure of conductivity of a solution)
µg/L	Micrograms per Liter (ppb)

Water Quality Data Table											
Contaminant	MCL		AVEK ¹	EAFB Wells		Distribution System ²		Months in Violation	Major Sources in Drinking Water		
Microbiological Contaminants (PDWS) ³											
Total Coliform	5% positive or 2 consecutive positive samples		0	1		1		0	Naturally present in the environment		
E. coli	1 positive sample		0	0		0		0	Human or animal fecal waste		
Contaminant	MCL	PHG	AVEK Plant Average ¹	AVEK Wells Average ¹	EAFB Wells Average	EAFB Well Range	Blended Average Range ⁴	West Base Average ⁵	Sample Date	Violation	Major Sources in Drinking Water
Arsenic (PDWS)											
Arsenic (µg/L)	10	0.004	5	4.3	7.9	2.9-12	2.6-9.6	2.9	2024	No	Erosion of natural deposits; runoff from orchards; glass and electronics production wastes
Contaminant	MCL	PHG	AVEK Plant Average	AVEK Wells Average	EAFB Average	EAFB Well Range	West Base Well Average	Sample Date	Violation	Major Sources in Drinking Water	
Inorganic Compound (PDWS)											
Aluminum (µg/L)	1000	600	32	0	ND	ND	ND	2024	No	Erosion of natural deposits; residue from some surface water treatment processes	
Barium	1000	2000	ND	29	4.4	0-22	20	2024	No	Discharges of oil drilling wastes and from metal refineries; erosion of natural deposits	
Total Chromium (µg/L)	10	MCLG = 100	ND	ND	1.66	ND-8.3	ND	2024	No	Discharge from steel and pulp mills and chrome plating; erosion of natural deposits	
Hexavalent Chromium (µg/L)	10	0.02	2.4	2.9	6.5	2.2-7.9	ND	2024	No	Discharge from electroplating factories, leather tanneries, wood preservation, chemical synthesis, refractory production, and textile manufacturing facilities; erosion of natural deposits	
Fluoride (mg/L)	2	1	ND	0.19	0.3	0.23-0.88	0.88	2024	No	Erosion of natural deposits; water additive that promotes strong teeth; discharge from fertilizer and aluminum factories	
Nitrate (mg/L)	10	10	0.59	2.1	0.134	ND-1.1	1.1	2024	No	Runoff and leaching from fertilizer use; leaching from septic tanks and sewage; erosion of natural deposits	
<p>1. AVEK data, including AVEK Plant Average and AVEK Wells Average, were obtained from 2024 & 2023 Kern County Annual Water Quality Report. Some contaminants are not required to be tested every year; thus this data was obtained from the 2023 report and earlier reports.</p> <p>2. Distribution System refers to sampling that are taken at final point of delivery to end user throughout the base.</p> <p>3. In 2024, there were 2 total samples that tested positive for bacteria. Our assessment indicates that weather conditions like extensive rainfall, stagnant water or error in sampling protocol may have affected the sampling results. In October, a repeat sample tested positive for total coliform bacteria after collection of a total coliform positive routine sample. Total coliform can cause short-term effects, such as diarrhea, cramps, nausea, headaches, or other symptoms. They may pose a greater health risk for infants, young children, the elderly, and people with severely compromised immune systems. After extensive testing and cleaning of the entire distribution system and water sources, the results indicated that there were no longer bacteria present. The results of the assessment set course of action items for the distribution system to include updating of the sampling protocol, cleaning the water storage tanks at the blending site, and training the individual that collected the positive sample. The water storage tanks were cleaned on 28 October 2024. No illnesses were reported as a result of the positive Total Coliform finding.</p> <p>4. Blended water is the water delivered to the end user. Because of the high levels of arsenic in the wells, EAFB is on an approved plan by the State Water Resources Control Board to blend with AVEK water. The blending ratio fluctuates seasonally, however in recent years AVEK water has been most of the water used. Water quality compliance is reported based on blended water results.</p> <p>5. Water provided to area around West Base is supply by a different source from the rest of Main Base, thus we have separated those sampling data to better represent West Base water quality.</p>											
<<< Table Continues on Next Page >>>											

Water Quality Data Table Continued

Contaminant	MCL	PHG	AVEK Plant Average	AVEK Wells Average	EAFB Average	EAFB Range	West Base Average	Sample Date	Violation	Major Sources in Drinking Water
Disinfectants & Disinfection By Products⁷ (PDWS)										
Total Trihalomethanes (µg/L)	LRAA ⁷ : 80		46	20	41	16-87	NA	2024	No	Byproduct of drinking water disinfection
Haloacetic Acids (µg/L)	LRAA ⁷ : 60		11	3.2	4	ND-10	NA	2024	No	Byproduct of drinking water disinfection
Lead and Copper⁸ (PDWS)										
Lead (mg/L)	AL=90% of bldgs. <15	0.2	ND	ND	0.0017	30 sites sampled; 0 sites over AL	N/A	2024	No	Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits
Copper (mg/L)	AL=90% of bldgs. <1.3	0.3	ND	ND	0.3	30 sites sampled; 0 sites over AL	N/A	2024	No	Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives
Radioactive Contaminants (PDWS)										
Gross Alpha (pCi/L)	15	0.2	ND	6.1	2.8	ND-6.6	11.2	2024	No	Erosion of natural deposits
Combined Uranium (pCi/L)	20	0.3	3.5	6.3	0.62	0-6.9	6.9	2024	No	Erosion of natural deposits
Tritium (pCi/L)	20000	400	N/A	5.9	ND	ND	ND	2021	No	Decay of natural and man-made deposits
5th Unregulated Contaminant Monitoring Rule										
PFOS (ppt)	4	1	N/A	N/A	ND	ND	ND	2024	No	Industrial sites, fire training, landfills, wastewater treatment
PFOA (ppt)	4	0.007	N/A	N/A	ND	ND	ND	2024	No	Industrial sites, fire training, landfills, wastewater treatment
Contaminant	Secondary MCL ⁹		AVEK Plant Average	AVEK Wells Average	EAFB Average	EAFB Well Range	West Base Well Average	Sample Date	Violation	Major Sources in Drinking Water
Secondary Standard Contaminants (SDWS)										
Alkalinity Bicarbonate (mg/L)	N/A		72	180	126	120-140	140	2024	No	Erosion of minerals and natural carbonate deposits
Calcium (mg/L)	N/A		31	70	26.8	20-34	30	2024	No	Leaching from natural deposits
Chloride (mg/L)	250		46	70	13.1	4.8-65	65	2024	No	Runoff/leaching from natural deposits; seawater influence
Hardness Total as CaCO ₃ (mg/L)	N/A		110	210	79.4	60-100	90	2024	No	The sum of polyvalent cations present in the water, generally naturally occurring magnesium and calcium
Iron (µg/L)	300		ND	4.9	52	ND-260	260	2024	No	Leaching from natural deposits; industrial wastes
Magnesium (mg/L)	N/A		8	8.5	3.1	2.3-3.7	3.4	2024	No	Erosion of minerals and natural deposits
Manganese (µg/L)	50		ND	ND	2.6	ND-13	ND	2024	No	Erosion of minerals and natural deposits; steel production and mining.
Sodium (mg/L)	N/A		34	40	68.6	42-120	110	2024	No	Leaching from natural deposits
Specific Conductance (µs/cm)	1		420	660	374	320-740	740	2024	No	Substances that form ions when in water; seawater influence
Sulfate (mg/L)	500		42	58	58.8	53-130	130	2024	No	Runoff/leaching from natural deposits; industrial wastes
TDS (m/L)	1000		210	390	246	220-480	480	2024	No	Runoff/leaching from natural deposits; industrial wastes

7. Disinfection Byproduct (DBPs), which includes Trihalomethanes and Haloacetic Acids. They are formed when disinfectant like chlorine is used to control microbial pathogens combine with naturally occurring materials found in source water.

8. Lead and Copper is regulated by ensuring the 90th percentile of sample result is under the AL. Sampling is conducted every 3 years. The most recent samples are from September 2024. All drinking water taps were sampled at Desert High School in 2023 with no Lead detected.

9. Secondary MCLs do not have PHGs or MCLGs because secondary MCLs are set to protect the aesthetics of water and PHGs and MCLGs are based on health concerns.

Additional Information Regarding Lead

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. 412th Bioenvironmental Engineering Flight and 412th Civil Engineering Squadron are responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (800-426-4791) or at <http://www.epa.gov/lead>. Additionally, a service line inventory was conducted in 2024 and there are no lead, galvanized requiring replacement, or lead status unknown service lines, known lead connectors or connectors of unknown material. A full report on the service line inventory has been attached to this report for reference.

Infants and young children are typically more vulnerable to lead in drinking water than the general population. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. If you are concerned about elevated lead levels in your home's water, you may wish to have your water tested and/or flush your tap for 30 seconds to 2 minutes before using tap water. Additional information is available from the U.S. EPA Safe Drinking Water Hotline (1-800-426-4791).

Additional Information Regarding Arsenic

While your drinking water meets federal and state standard for arsenic, it does contain low levels of arsenic. The arsenic standard balances the current understanding of arsenic's possible health effects against the costs of removing arsenic from drinking water. The U.S. Environmental Protection Agency continues to research the health effects of low levels of arsenic which is a mineral known to cause cancer in humans at high concentrations and is linked to other health effects such as skin damage and circulatory problems.

Additional Information Regarding Fluoride

The Main Base water systems contain naturally occurring fluoride. Main Base does not add additional fluoride to the water system due to State requirements and the scope/size of the EAFB water distribution system. The natural level of fluoride present in the water system is below the maximum contamination limit (MCL) of 2.0 parts per million (ppm).

In 2015, the U.S. Department of Health and Human Services released a Public Health Service recommendation of 0.7 mg/L as the optimal fluoride level in drinking water to prevent tooth decay. Your local dentist or pediatrician can prescribe daily fluoride brushing, tablets, or drops for you and your children to ensure you receive enough fluoride.

Tips for Protecting Your Water

- Eliminate excess use of lawn and garden fertilizers and pesticides – they contain hazardous chemicals that can reach your drinking water source.
- Pick up after your pets.
- Dispose of chemicals properly; take used motor oil to a recycling center.

For more information regarding this report, please contact either:

- 412th Operational Medical Readiness Squadron – Bioenvironmental Engineering Flight (661-277-3272)
- 412th Test Wing – Public Affairs (661-277-1454)



Distribution System Water Quality

Protecting Water Quality through Cross-Connection Control and Backflow Prevention




Cross-connections are actual or potential connections between a potable water supply and nonpotable water plumbing. Backflow is the unintended reversal of water flow through a cross-connection, which can result in a potentially serious public health hazard. A cross-connection control and backflow prevention program helps prevent contaminants from entering a drinking water distribution system. This fact sheet is part of EPA's Distribution System Toolbox developed to summarize best management practices that public water systems (PWSs), particularly small systems, can use to maintain distribution system water quality and protect public health.

Examples of Utility Actions

At a western United States (U.S.) PWS serving 2,500 people, a customer created a cross-connection when they connected a surface water irrigation line to the water system without installing an approved backflow prevention assembly. Irrigation water flowed back into the county water system when the pressure in the irrigation line increased. Samples tested positive for *E. coli* and the Department of Water issued a "Do Not Use" notice to customers.

A PWS in the southeastern U.S. serving 500,000 people experienced a cross-connection and backflow incident where aqueous fire-fighting foam was forced into the homes of an estimated 40,000 customers. After review of the incident, the PWS installed a backflow prevention assembly.

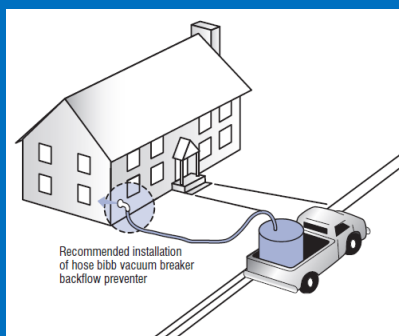

Cross-Connection Control, Backflow Prevention, and Water Quality

- Backflow of untreated water through an unprotected cross-connection can lead to serious chemical or microbiological contamination in distribution systems.
- Cross-connections can occur between the PWS distribution system and private irrigation systems, fire sprinkler systems, and other piping systems that receive PWS drinking water.
- When the pressure in a PWS distribution system is lower than in the connected plumbing system, backflow contamination can occur.
- A study published by the Water Research Foundation in 2010, using backflow-detecting water meters, found that 5% of homes registered a backflow incident of 1 gallon or more each year. However, the impact of these residential backflow incidents on distribution system disinfectant residual remains undetermined.
- Cross-connection and backflow prevention programs vary by state and municipality. Additional information may be available from state drinking water programs, building code or plumbing authorities, and health departments.
- Sanitary surveys, conducted at least once every three years for community water systems and once every five years for non-community PWSs, offer opportunities to identify potential cross-connections that put public health at risk.

Indicators of a Cross-Connection and Backflow Incident

- Customer complaints of odor, discoloration of water, or direct physical harm are the primary indicators of a backflow incident.
- Decreases in water pressure can indicate the occurrence of a backflow incident, as well as suggest where the incident may have occurred.
- A short-term reduction in disinfectant residual could indicate a potential backflow incident.
- During periods of reversed flow, water meters might run in reverse.

Example of a double check backflow prevention assembly



Disclaimer: To the extent this document mentions or discusses statutory or regulatory authority, it does so for information purposes only. It does not substitute for those statutes or regulations, and readers should consult the statutes or regulations themselves to learn what they require. The mention of trade names for commercial products does not represent or imply the approval of EPA.

Cross-Connection Control and Backflow Incident Response

- In the case of a backflow incident, reverse the pressure differential that caused the backflow, if possible.
- Identify and eliminate the cross-connection or install a backflow prevention assembly or device that meets local and state requirements.
- Perform a systematic flushing or cleaning of the system while strategically minimizing the risk of drawing contaminants into uncontaminated areas.
- Throughout the incident, continue to sample within and outside of the suspected contamination area to assess the extent of the contamination.
- Maintain compliance with local discharge regulations for disposal of potentially contaminated water.
- After flushing and cleaning, test the drinking water in the affected areas to ensure it meets regulatory standards.

Example Elements of an Effective Cross-Connection Control and Backflow Prevention Program

- **Legal authority:** PWSs may need legal authority to implement and enforce the program, like requiring customers to install and maintain backflow prevention assemblies. Rules may vary from state to state in terms of allowable backflow prevention assemblies for different hazard types, testing frequency, and remedial repair options.
- **Trained personnel:** All backflow prevention staff should be trained and certified in testing backflow prevention assemblies and distribution system operations. Certification requirements may vary from state to state.
- **Recordkeeping:** Recordkeeping should cover testing and repair activities, certification of inspection and repair personnel, and records associated with backflow prevention assemblies in service, including inspection dates and results.
- **Public education:** PWS customers should understand the potential health risks posed by cross-connections and backflow and their responsibilities for testing and repairing backflow prevention assemblies on irrigation systems or other potential cross-connections.

Table 1: Resources and Guidelines for Cross-Connection Control and Backflow Prevention

Resource Title and URL	Relevance to Cross-Connection Control and Backflow Prevention
ASDWA. 2020. Distribution System Survey White Paper. http://www.asdwa.org/	Summarizes survey findings about state cross-connection control programs.
AWWA. 2015. M14 Backflow Prevention and Cross-Connection Control: Recommended Practices. https://www.awwa.org/	Provides an in-depth analysis of causes and prevention of backflow and cross-connections in potable water systems.
University of Southern California Foundation for Cross-Connection Control and Hydraulic Research. 2012. Manual of Cross-Connection Control, Tenth Edition. https://fccchr.usc.edu/ List of Approved Backflow Prevention Assemblies. https://fccchr.usc.edu/list.html	The manual covers all aspects of cross-connection control and backflow prevention. Associated resources available on the FCCCHR website include a list of tested and approved backflow prevention assemblies and field test kits, training videos, and sample forms to be used in a cross-connection control program.
USEPA. 2006. Cross-Connection Control: A Best Practices Guide. http://nepis.epa.gov/	A concise summary of best practices for cross-connection control.
USEPA. 2003. Cross-Connection Control Manual. http://nepis.epa.gov/	Defines, describes, and illustrates typical cross-connections and suggests simple methods and devices by which cross-connections can be eliminated without interfering with the functioning of plumbing or water supply distribution systems.

ATTENTION

EDWARDS AIR FORCE BASE RESIDENTS

*Please Read the Following Backflow Prevention Guidelines
Carefully and Help Us Keep Our Water Safe!*

What is Backflow?

Backflow is when a drop in the incoming water pressure allows a reverse flow from a homeowner's plumbing system back into the public water system. For example, if you have a garden hose submerged to fill a bucket, Jacuzzi, fish tank, etc., and the water system suddenly loses pressure, the flow of water can be reversed, sucking any contaminants in the water backwards into the system.

A Cross-Connection is any physical connection between a possible source of contamination and the public water system. For example, if a homeowner uses a cistern or an old well for outdoor watering, it cannot be connected to pipes that are connected to the public water system. Even with a bypass valve in place, it is prohibited.

Why is Preventing Backflow Important?

Cross connection control is extremely important in public water systems as it is a matter of public health and safety. Many contamination issues in public water systems, including bacteria from sewage, are not due to the water source but are due to cross-connections. Therefore, it is very important that all customers are aware of the dangers and take necessary precautions.

Examples of Cross-Connection and Backflow Scenarios

- Water softener, under-sink reverse osmosis unit, or water filter discharge tubing connected to a drain creates a direct connection to the sewage system.
- A bottled water system such as a water cooler that is connected to the home's plumbing system could contaminate the water system if the bottled water becomes contaminated.
- A toilet in your home installed prior to 1964 that does not have an anti-siphon fill valve to prevent backflow from the tank into the water supply.
- Soapy water or other cleaning compounds could back siphon into your water supply plumbing through a faucet or hose submerged in a bucket, basin, or mop sink.

- An aquarium, dishwasher, or sink that fills from below the normal water level provides a conduit for contaminants to enter the water supply plumbing.
- A hose submerged in a swimming pool creates a pathway for pool water to enter the water supply plumbing.
- Fertilizers/pesticides or animal waste can be drawn into the water supply plumbing from a lawn irrigation system with submerged nozzles.

What Can You Do?

- ✓ Be aware of and eliminate cross-connections and backflow scenarios.
- ✓ Maintain air gaps. Do not submerge hoses or place them where they could become submerged (create a gap of air between supply and container, see attached photographs). The air gap should be a distance of twice the diameter of the outlet pipe.



Figure 1. Air Gap Separation

- ✓ Use hose bib vacuum breakers on fixtures (hose connections in the basement, laundry room and outside) (see attached photograph of a hose bib vacuum breaker).
- ✓ Make sure toilets have anti-siphon ballcock assemblies.
- ✓ Do not create a connection between an auxiliary water system (well, cistern, body of water, puddles) and the water supply plumbing.

Backflow Prevention Examples



Air Gap Example 1



Air Gap Example 2



Hose Bib Vacuum Breaker

A summary of Edwards AFB's drinking water service line inventory

A service line inventory is a comprehensive record used by public water systems to identify the materials of all service lines, with a focus on detecting lead. It includes both system- and customer-owned parts of the line, classifies each as lead, non-lead, galvanized requiring replacement or unknown. It also documents key components and locations. The inventory helps systems comply with EPA regulations, prioritize lead line replacements and reduce lead exposure in drinking water systems. The EPA also requires a summary of the inventory to be made available to water users. That summary is included below.

PWS Information

Purpose of this worksheet: For water systems to document basic system information.

Facility Information

Water System Name:

EDWARDS AFB - MAIN BASE

PWSID:	Population Served (number of people):	Number of Service Connections:	PWS Type:
CA1510701	11,316	1088	<input checked="" type="checkbox"/> CWS <input type="checkbox"/> NTNCWS

Mailing Address

Street or P.O. Box:

70 N. WOLF AVE

City or Town:	State:	Zip Code:
Edwards AFB	CA	93524

System Contact Person

Name:	Title:
Mark Edwards	Chief, Infrastructure Maintenance Flight
Telephone:	Email:
(661) 275-2190	mark.edwards@us.af.mil

Person Who Prepared Inventory (if different from above)

Inventory Methodology

Enter Date Last Updated: 09/11/24

Purpose of this worksheet: For water systems to document the methods and resources they used to develop and update their inventory.

Part 1: Historical Records Review

Type of Record	Describe the Records Reviewed for Your Inventory
1. Construction Records and Plumbing Codes <i>Examples: Local ordinance adopting an international plumbing code. Permits for replacing lead service lines.</i>	Real property records, utility master plans, and as-built drawings.
2. Water System Records <i>Examples: Capital improvement plans. Standard operating procedures. Engineering standards.</i>	Geographic Information System (GIS) potable water data. Real property records and as-built drawings.
3. Distribution System Inspections and Records <i>Examples: Distribution system maps. Tap cards. Service line repair/replacement records. Inspection records. Meter installation records.</i>	
4. Other Records	

Part 2: Identifying Service Line Material During Normal Operations

1. During which normal operating activities are you collecting information on service line material? Check all that apply.

- | | |
|---|---|
| <input type="checkbox"/> Water meter reading | <input type="checkbox"/> Water main repair or replacement |
| <input type="checkbox"/> Water meter repair or replacement | <input checked="" type="checkbox"/> Backflow prevention device inspection |
| <input type="checkbox"/> Service line repair or replacement | <input type="checkbox"/> Other |

If "Other", please explain:

2. Did you develop or revise standard operating procedures to collect service line material information during normal operation? No

If "Yes", please describe:

Part 3: Service Line Investigations

1. Identify the service line investigation methods your system used to prepare the inventory (check all that apply).

- | | |
|--|--|
| <input checked="" type="checkbox"/> Visual Inspection | <input type="checkbox"/> Water Quality Sampling - Other |
| <input type="checkbox"/> Customer Self-Identification | <input type="checkbox"/> Predictive Models or Statistical Analysis |
| <input type="checkbox"/> Pipe Dating | <input type="checkbox"/> Interpolation |
| <input type="checkbox"/> Pipe Diameter | <input type="checkbox"/> Interviews |
| <input type="checkbox"/> Water Quality Sampling - Targeted | <input type="checkbox"/> Emerging Methods |
| <input type="checkbox"/> Water Quality Sampling - Flushed | <input type="checkbox"/> Other |
| <input type="checkbox"/> Water Quality Sampling - Sequential | |

If "Other" or "Emerging Methods," please explain:

2. If "Predictive Modeling" or "Interpolation," please briefly describe the model and inputs used.

3. How did you prioritize locations for service line materials investigations? For example, did you consider environmental justice and/or sensitive populations, did you use predictive modeling, and/or did you target areas with high number of unknowns?

All service lines were investigated through record review or non-intrusive field investigations.

Detailed Inventory

Date Last Updated:9/12/2024

Purpose of this worksheet: To provide a template for water systems to track materials for each service line in their distribution system.

General Instructions: Each row in this worksheet represents one service line connecting the water main to the customer's plumbing. The columns with the aqua shading are required for the Inventory Summary tab. Note that users can freeze panes to enable them to see the headings and notes when entering data. The worksheet includes example rows and is formatted for approximately 10,000 entries. Please refer to the red triangle in the upper corner for additional instructions.

Location Information			System-Owned Portion										Customer-Owned Portion										Entire Service Line Material Classification (If error or "Missing Information" appears in either column, fill in correctly. See instructions).
Unique Service Line ID	Street Address	Other Locational Identifier	System-Owned Portion Service Line Material Classification	Lead Connector Present?	If Material Anything Other than "Lead" in Column C, Was Material Ever Previously Lead?	Service Line Installation Date	Service Line Size (Inches)	Basis of Material Classification	Was the Service Line Material Field Verified?	Describe the Field Verification Method	Enter the Date of Field Verification	Notes	Customer-Owned Portion Service Line Material Classification	Service Line Installation Date	Service Line Size (Inches)	Basis of Material Classification	Was the Service Line Material Field Verified?	Describe the Field Verification Method	Enter the Date of Field Verification	Notes			
24	8046 24		Non-Lead - Copper	Don't Know	No			Historical records					Non-Lead - Copper			Historical records				Non-Lead			
143	8046 238		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
143.1	8046 245		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
143.2	8046 245		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
143.3	8046 245		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
143.4	8046 245		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
143.5	8046 245		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			
1436.1	8046 252		Non-Lead - Other	Don't Know	No			Historical records					Non-Lead - Other			Historical records				Non-Lead			

Error Count:
Rows Missing Information:

Inventory Summary

Enter Date Last Updated: 09/11/24

Purpose of this worksheet: For water systems to provide a summary of their service line inventory, including information on ownership, inventory format, and the number of service lines for each of the four required materials classifications.

Part 1. General Information

1. Is this the Initial Inventory or an Inventory Update ?	<i>Initial Inventory</i>
2. Who owns the service lines in your system? <i>If other, please explain below.</i>	<i>The entire service line is owned by the water system</i>
3. When were lead service lines banned in your system? Reference the state or local ordinance that banned the use of lead in your system. The system is a federal facility and follows the federal Safe Drinking Water Act (SDWA) Lead ban instituted on June 19, 1986 which prohibited use of pipe, solder, or flux in Public Water Systems that is not "lead free". California implemented the lead ban effective January 1986, as outlined in Chapter 300.6 of the CA Health and Safety Code (CA HSC 1985).	
4. Do you have lead goosenecks, pigtails or connectors in your system?	<i>No</i>

Part 2. Inventory Format

Describe your inventory format in the space provided below (e.g., the **Detailed Inventory** worksheet, custom spreadsheet, GIS map). Provide the filename and/or web address if applicable.

Detailed Inventory Worksheet in the State-specified template.

Part 3. Inventory Summary Table ¹

If you are using the **Detailed Inventory** worksheet, the classifications you select in the Column "Entire Service Line Material Classification" will be used to calculate the total number of service lines for each of the four material classifications below. Otherwise, enter the number of service lines blue- and aqua colored-cells.

Table 3.1. Inventory Summary by Ownership

Service Line Material Classification	Number of Water System Owned Service Lines	Number of Customer Owned Service Lines
Lead	0	0
Galvanized	6	6
Galvanized Requiring Replacement	0	0
Non-Lead - Copper	22	22
Non-Lead - Plastic	970	970
Non-Lead - Other	90	90
Unknown	0	0
TOTAL	1088	1088

Table 3.2. Inventory Summary Total

Service Line Material Classification	Definition	Total
Lead	Any portion of the service line is known to be made of lead.	0
Galvanized Requiring Replacement (GRR)	The service line is not made of lead, but a portion is galvanized and the system is unable to demonstrate that the galvanized line was never downstream of a lead service line.	0
Non-Lead	All portions of the service line are known NOT to be lead or GRR through an evidence-based record, method, or technique.	1,088
Lead Status Unknown	The service line material is not known to be lead, GRR, or non-lead line. For the entire service line or a portion of it (in cases of split ownership), there is no evidence to support material classification.	0
Lead Gooseneck/Fitting	A short section of piping, typically not exceeding two feet, which can be bent and used for connections between rigid service piping.	0
Total Number of Service Lines		1,088

Notes

This summary table is for reporting material for the entire service line connecting the water main to the customer's plumbing. See the Section 4 of the Inventory Instructions or Exhibit 2-2 of U.S. EPA's Guidance for Developing and Maintaining a Service Line Inventory (US EPA, 2022).

Public Accessibility Documentation

Enter Date Last Updated:

09/11/24

Purpose of this worksheet: For systems to provide documentation to states on how they met the public accessibility requirements of the LCRR.

1. Select the location identifiers that you use for your service line inventory. Check all that apply.

- ☐ Address
- ☐ Street
- ☐ Block
- ☐ Intersection
- ☐ Landmark
- ☐ GPS Coordinates
- ☒ Other

If "Other", please describe:

Unique Air Force Facility IDs for buildings, structures, and recreational areas are used for the "Unique Service Line ID" with "-1", "-2", etc. following to represent each service line for that facility.

2. Does **every service line** have a location identifier?

Yes

If "No", explain. Remember that location identifiers are required for service lines that are lead and galvanized requiring replacement.

3. How are you making your inventory publicly accessible? Check all that apply. Remember that if your system serves > 50,000 people, you **must** provide the inventory online.

- ☐ Interactive online map
- ☐ Static online map
- ☐ Online spreadsheet
- ☐ Printed service line map
- ☐ Printed tabular data
- ☐ Information on water utility mailings or newsletter
- ☒ Hard copy information available in water system office
- ☒ Other

If "Other", please describe:

Excel version of the service line inventory is aslo available for viewing at the water system office.